

Figure 1

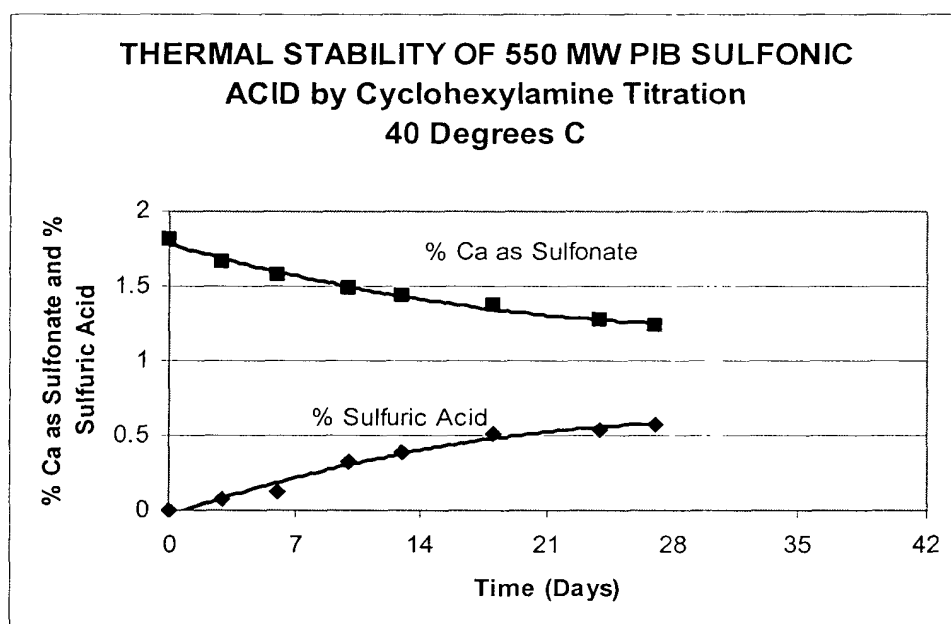


Figure 2

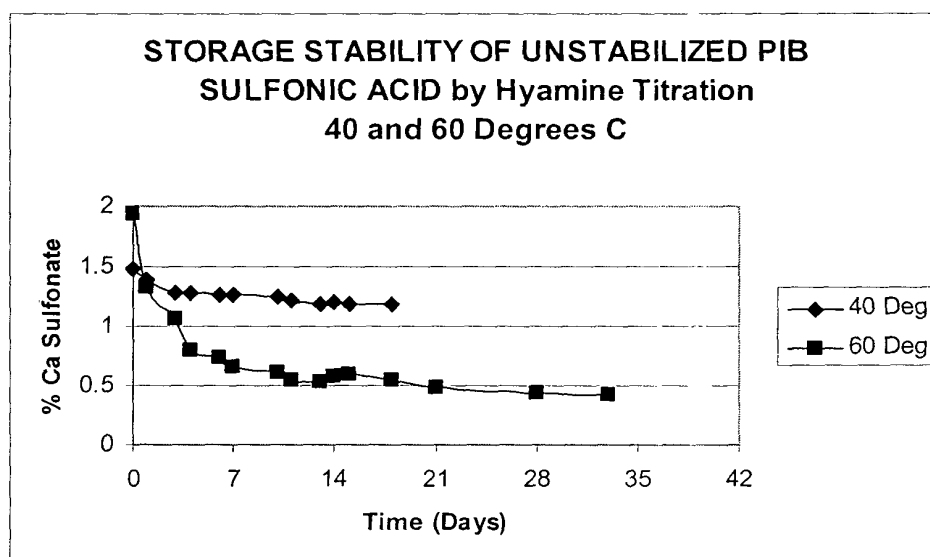


Figure 3

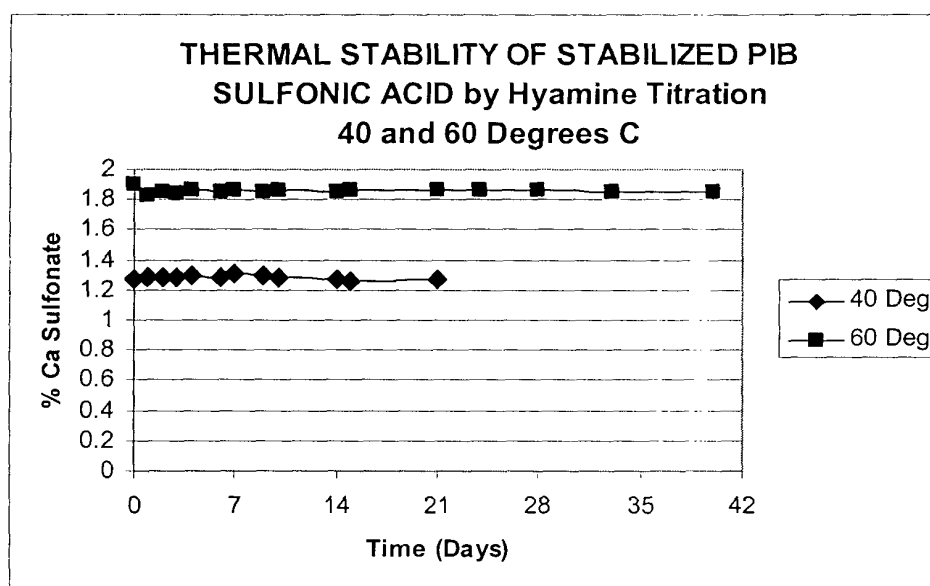


Figure 4

Negative Ion Electrospray Mass Spectrometry (ESMS) Spectrum of  
Unstabilized (Non-Neutralized) 550 MW PIB Sulfonic Acid

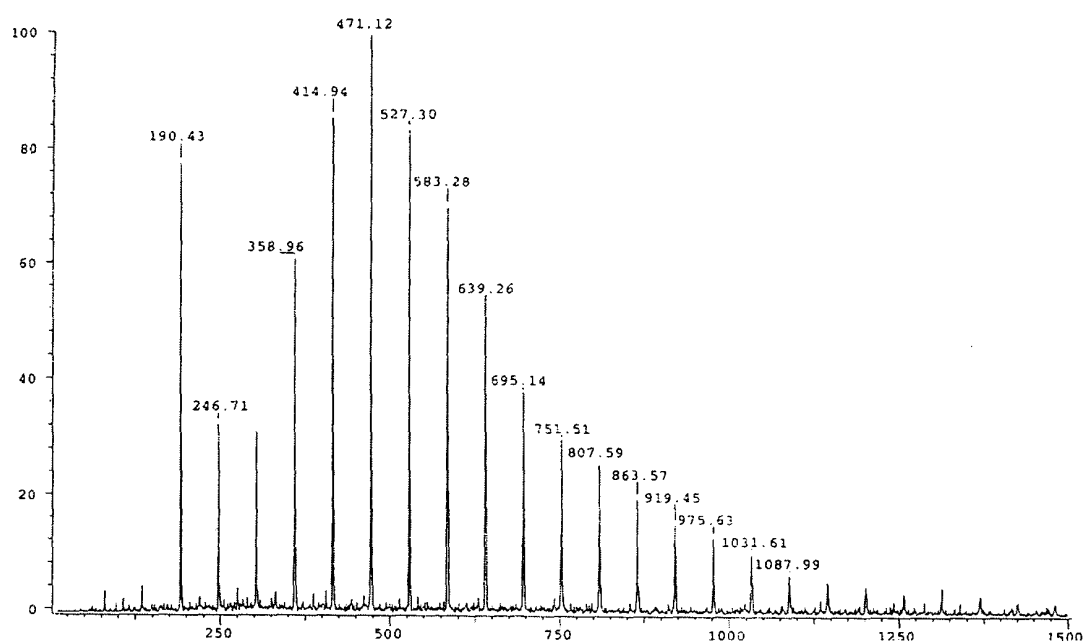


Figure 5

Negative Ion Electrospray Mass Spectrometry (ESMS) Spectrum  
of Stabilized (Neutralized) 550 MW PIB Sulfonic Acid

